



Front View

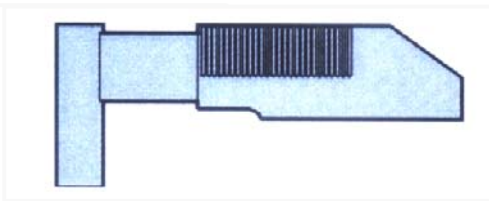

Side View

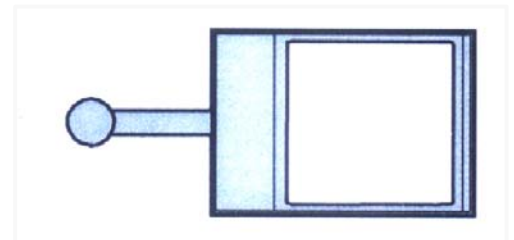

Bottom View

Notes:

1. Luminaire to be only used with MANARC approved poles or columns.
2. AR/SAR luminaire with high pressure sodium lamps to be used only for street lighting. AR/SAR luminaire with metal halide lamps to be used for amenity type situations only or with specific MCC approval at pedestrian crossings.
3. Luminaire to comply with MCC Public Lighting Design Standard requirements and
 - a. Be manufactured in accordance with AS/NZS 60598.1 and tested in accordance with AS/NZS 60598.2.
 - b. Have steel materials and fasteners complying with NZS 3404.1 or AS 4100.
 - c. Dissimilar metals shall not be in contact with each other.
 - d. Have lighting complying with AS/NZS 1158.
 - e. Have luminaire and control gears that are readily accessible and easily maintainable without using special tools.
 - f. Use 250, 150 and 70 standard lamp wattages for high pressure sodium lamps and 400, 250 and 150 standard lamp wattages for metal halide lamps.

MANARC

MANUKAU CITY APPROVED
REQUIREMENT

UPDATED:

APR 2005

DETAIL No:

MR-28

DETAIL:

ARCHETYPE AR/SAR KIM LUMINARIES

MANUKAU CITY COUNCIL